

Asbestos Containing Materials Survey - Part 5



Property Number (PMS): PTM001
Property Name: PTM Group
Property Address: Lot 6918 Damaso Place Stuart Park
NT

Number of Structures: 1
Report Creation Date: 01 Sep 2015

Asbestos Solutions NT
PO Box 42110
Casuarina NT 0811
Tel: 0451 832 064
Email: asbestossolutionsnt@bigpond.com

Audit Summary

Introduction

Asbestos Solutions NT were contracted by PTM Group Pty Ltd to carry out a Part 5 Asbestos audit on the Building located at 6918 Damaso Place Stuart Park NT

Site Description

The site is a Warehouse and Office facility.

Area Included

All Buildings and structures on the site.

Area Excluded

All underground Power, Water and Sewerage services.

Comments

No suspected materials were detected during the survey and therefore no samples were necessary.

Survey Findings

Refer to Appendix A in the Asbestos Register.

Contents

1	Definitions	1
2	Introduction	2
	2.1 Background.....	2
3	Scope of Works	3
	3.1 Purpose.....	3
	3.2 Nature of Survey.....	3
4	Limitations	3
	4.1 Conditions of Engagement	3
	4.2 Accuracy	4
	4.3 Completeness of Inspection.....	4
5	Methodology	5
	5.1 Firedoors	6
	5.2 Vinyl Tiles.....	6
	5.3 Air Conditioning Ducts	6
	5.4 Sampling Procedures.....	6
6	Risk Evaluation	7
	6.1 Introduction.....	7
	6.2 Methodology.....	7
	6.3 Priority Ratings.....	8
7	References	10

Appendix A: Asbestos Register

Appendix B: Laboratory Results

Appendix C: Site Plan

Definitions

Act

An Act is a primary legislative instrument - it may give authority for the making of another legislative instrument. The role of an Act is to constitute the process of formulating general rules or conduct without reference to particular cases and they usually operate in the future. Acts state the general principles of a scheme.

Asbestos

Asbestos refers to the fibrous form of mineral silicates arising from serpentine and amphibole rock forming minerals. These silicates include:

Serpentine Group

- Chrysotile (white asbestos)
- Amphibole Group
- Amosite (brown asbestos)
- Crocidolite (blue asbestos)
- Actinolite, tremolite and anthophyllite.

Asbestos may also be considered as any mixture of the above groups.

Materials containing asbestos may include “fibro” products, spray-on fireproofing, soundproofing/thermal insulation, acoustic plaster, and insulation and friction materials such as brake linings, clutch pads, gaskets and seals.

Asbestos has been used as insulation for pipes, autoclaves, ovens, mattresses, heat blankets, rope, vinyl tiles, fire doors, building material (sheet), piping, laboratory bench tops, switchboards, clutch linings, batteries and many other uses.

Asbestos is typically found in buildings more than 25 years old, as cement sheeting, spray-on fireproofing, black electrical mounting boards, vinyl flooring, asbestos wire insulation and at times, within boilers and heating units.

Asbestos Cement Sheet (AC)

Asbestos cement sheet is a building material, which is a composite of asbestos fibres, plant fibres, cement and sand. This includes flat or corrugated compressed sheeting, pipes and roof shingles.

Asbestos Containing Materials (ACM's)

Asbestos containing materials are any material that contain asbestos.

Asbestos Related Activities

Activities which involve the identification, evaluation and control of asbestos situations, including removal.

Code of Practice

A Code of Practice provides practical guidance for prevention, assessment and control of the subject matter. It is designed to assist in the implementation of the provisions of associated regulations.

Friable

The term friable is used to describe asbestos containing material or synthetic mineral fibres that can be crumbled, pulverised or reduced to particles by hand pressure when dry. Friable asbestos is considered to represent a particular hazardous state. It typically includes spray-on insulation, fireproofing or soundproofing.

Presumption Criteria

Where samples have not been taken (i.e. restricted access) the suspect samples are simply presumed to contain asbestos. Or if materials historically contain asbestos and visual inspection confirms the likelihood that asbestos is present (i.e. gaskets) then again these areas are presumed to contain ACM. The presumption criteria can also be used where a facility contains multiple suspected areas which likely contain ACM (i.e. fire doors).

Once the presumption has been made the material must be treated as an ACM with work practices and disposal criteria as required for the presence of asbestos, until the material is removed or testing has confirmed that it does not contain asbestos.

Regulation

Regulations deal with matters of administrative or technical detail, particularly where this detail may need to be changed from time to time.

Introduction

Background

Asbestos Solutions NT has been engaged to:

- Undertake a Part 5 re-survey of asbestos containing materials (ACM's) located at the site.
- Prepare an asbestos register.

This survey is to assist the client and building management in identifying the location of ACM's at the site and to provide a basis for the ongoing management.

Scope of Works

Purpose

The purpose of the asbestos survey is to identify the locations and condition of ACM's within the building and to provide advice in relation to appropriate ongoing management of the identified materials. This survey forms part of the overall responsibility as owner/occupier of the property.

Nature of Survey

The surveys consisted of the following:

- An inspection of the property.
- Collection of samples (where required).
- Confirmation of existing ACM's and their condition
- The addition of any new suspected ACM's.
- Register update.

The survey was developed in accordance with the following codes of practice and guidelines:

- Code of Practice for the Management and Control of Asbestos in Workplaces. [NOHSC:2018 (2005)].

The asbestos survey did not include the following:

- An investigation or assessment of areas of the site that were not readily accessible or practicable to access on the day (including within switchboards, lift infrastructure, internal air conditioning and heating units). Practicable in this sense means that plant and equipment would have had to be dismantled, or unacceptable damage would have been incurred if the inspection had proceeded or in operation and therefore unsafe to investigate.
- Reviews of any licenses or approvals held in relation to the use, handling or presence of ACM's at the site, or past, current or proposed removal or treatment of ACM's at or from the site.

Limitations

Conditions of Engagement

Whilst this survey has been prepared in a manner consistent with the level of quality and skill generally exercised by members of Asbestos Solutions NT profession, it must be read and interpreted subject to the following limitations:

- The survey was prepared solely for the purpose described in Section 2.1. It should not be relied on, or used by, the client for any other purpose.

- The survey was prepared solely for the client and should not be relied on, or used by, any other party for any purpose whatsoever.
- Where information referred to in the survey was obtained from third parties, Asbestos Solutions NT has not independently verified the accuracy or comprehensiveness of the information supplied and accepts no responsibility or liability arising from any inaccuracies or omissions in the information supplied.
- Although care was taken during the site inspection to identify all asbestos containing materials at the site, asbestos may be present at the site in concealed areas or locations of the property not accessed at the time of inspection.
- The information contained in this survey is based on conditions that existed at the date of the survey. No responsibility for matters or events arising after that date is accepted. In particular, the survey cannot be relied on if alteration or demolition work is undertaken in the future or if site conditions change or are altered, after the date of the survey.
- The survey is not for the purposes of an Occupational Health and Safety (OH&S) Assessment. The survey is in no way to be considered or interpreted as a review of the legal obligations pertaining to the site or as an assessment of compliance of the site with legal standards or obligations or subsequent regulations.
- The information contained in this survey should only be presented in full and may not be used to support any other objectives other than those stated in this survey. In particular, the asbestos materials register, and other appendices attached to the survey should not be separated from the body of the survey for any purpose or use whatsoever.
- This survey should not be used for the purpose of tendering, preparing costing or budgets, programming of work, refurbishment of works or demolition work.

Accuracy

The information contained in this survey is considered to be accurate on the date of the survey in accordance with the current conditions of the site. These conditions may vary from time to time as the result of further activity that may influence the condition of the ACM's identified at the site. In addition, limited non destructive sampling was undertaken at the site. As a result the inspection cannot be regarded as absolute.

Completeness of Inspection

Locations where the assessment of asbestos may not have been practicable include, but are not limited to:

- Internal sections of air-conditioning systems and hot water/heating systems, wall partitions, fire doors and electrical light fittings.

- Concealed or inaccessible areas or voids within the building such as wall cavities, beneath floors, carpets and slabs, above fixed ceilings and confined spaces.
- Integral parts of boilers, pumps, machinery, plant and pipe work.
- Areas where the presence of asbestos containing materials was not considered to represent a significant exposure risk.
- ACM's concealed by other materials, preventing visual access or identification or installed in non-typical applications.

No asbestos survey can guarantee to identify all ACM's present in a building. Whilst this survey has been prepared in a manner consistent with the level of quality and skill generally exercised by members of Asbestos Solutions NT profession, there is no guarantee, expressed or implied, that all ACM's have been identified in this survey.

Based on the above information, further investigation and sampling will be required prior to demolition or refurbishment works.

Methodology

The inspection consisted of a visual check of suspected asbestos materials within the premises and sampling when required based on professional judgement.

Details of the sample collection are provided below and the results are provided in Appendix A.

The methodology is a risk-based approach, which seeks to identify ACM that are commonly found at properties more than 25 years old. The approach involves both visual and laboratory identification of ACM's which are readily accessible at the property, and may represent a health risk if disturbed.

Where samples are not able to be taken it is sometimes necessary to presume the material contains asbestos. Once such a presumption has been made, the material must be treated as an asbestos containing material until it is confirmed by analysis or removed.

Samples were not taken from the following materials suspected as containing asbestos:

- Switchboards located throughout the building.
- Fire Doors.
- Air Conditioning ducts.
- Vinyl tiles.
- Mastics, sealants, adhesives and paints.

These have not been sampled because in some cases these materials are considered low risk, samples are not possible (i.e. from fire doors as sampling effects the integrity of the door) or for economic reasons.

Firedoors

While all care has been exercised to ensure all fire doors have been checked and labelled it is possible that some fire doors have been missed or were not accessible during the audit. Asbestos free fire doors will be labelled "Asbestos Free" on the nameplate or will have a recently dated nameplate. Before any work is performed on any fire door Asbestos Solutions NT that the nameplate is checked in consultation with the register, if there is any doubt then the fire door should be treated as containing asbestos until verified otherwise.

Vinyl Tiles

While all care has been exercised to ensure all vinyl tiles have been checked and labelled it is possible that some vinyl tiles have been missed, were not accessible during the audit or previous analysis have concluded that the tile does not contain asbestos (when in fact due to the non-homogeneous nature of vinyl tiles it may contain asbestos, just not in the area sampled). If there is any doubt about whether a vinyl tile contains asbestos then the vinyl tile should be treated as containing asbestos until verified otherwise.

Air Conditioning Ducts

While all care has been exercised to ensure all HVAC systems have been checked for ACM millboard it is possible that some ACM components have been missed or were not accessible during the audit. If there is any doubt about whether a HVAC system contains ACM's then the system should be treated as containing asbestos until verified otherwise.

Sampling Procedures

Asbestos Containing Materials

All samples were collected using pinch pliers or other appropriate sampling equipment. While samples were being collected, all relevant safety procedures were adhered to in accordance with relevant OH&S procedures and Codes of Practice. Suspected materials are regarded as potentially containing asbestos and full precautions applied.

Samples were collected from suspected ACM's and particularly those of a friable nature. A discrete and non-destructive technique of sampling was used to minimise any obvious sign of damage and limit any damages to the integrity of the material.

Due to the operating nature of the premises, no samples were taken from within air plenums such as air conditioning fan rooms, operating furnaces, fire doors, heaters or other locations where non-destructive safe sampling cannot be conducted.

All tools were cleaned throughout, following each sample collection, to prevent any cross contamination, in some cases, adjoining areas were also wiped clean. All disposable materials, which were likely to have come in contact with any ACM's, were double sealed into plastic bags for subsequent disposal.

In all cases attention was paid to the collection of representative samples. When variations in colour, texture, etc. were noted, additional sampling was initiated.

Asbestos containing materials not considered to represent a significant exposure risk include, but are not limited to; paints, mastics, sealants, adhesives and similar materials. Such materials were typically not sampled.

Field Log-Sheets

The field inspector recorded each sample of suspected ACM's on a field log-sheet as it was collected. Such field log-sheets include information on the date, time, sampling location and sample number.

Sample Labelling

Each sample of suspected asbestos was placed in an individual re-sealable plastic bag, which was sealed in a second plastic bag before dispatch to the laboratory. Each bag was then labelled with a unique numbering system, which enabled laboratory staff to identify and track samples.

Sample Examination

Samples were analysed by NATA certified laboratories that use polarised light microscopy and X-ray diffraction to identify the presence of asbestos.

Risk Evaluation

Introduction

A qualitative risk evaluation was performed to identify the hazards posed to site occupants by the ACM's identified on the site. The evaluation consists of risk assessment on the identified ACM's and assigning a priority rating system for the management of such materials.

Methodology

Assessment of Risk

The risk evaluation is based on an assessment of a range of factors, such as the friability, location and condition of the identified materials.

In addition, the auditors have also considered the nature of the work in relation to the vicinity of the building occupants. In all circumstances the methods adopted have aimed to minimise the likelihood of fibres releasing into occupied space.

The above factors have been utilised in the process of determining appropriate recommendations for the timing of assessment activities and have assisted in the development of the management plan.

Priority Rating System

The priority rating systems in the following section were designed as a guide for the development of a management plan. The actual setting of priorities for implementation of control procedures will depend not only on the allocated rating, but also on factors such as changes to work practices or the physical environment that occur during refurbishment or demolition. In spite of this, the allocated rating does provide a reasonable guide to the appropriate priority setting with regard to the current condition of the materials.

Priority Ratings

Asbestos Containing Materials Ratings

There are four priority ratings in the system as outlined below. They are a guide only and the client should decide the most appropriate controls based on such factors as risk, detailed knowledge of workplaces and procedures, plans for upgrade or refurbishment.

Priority Rating for Control of Asbestos Containing Materials

Priority 1 – P1	Immediate Risk Level
<p>This level of risk is applicable to the presence of friable material, such as limpet asbestos insulation and asbestos ropes, especially if in a deteriorating state. It presents an immediate health risk in its current condition and location and immediate control measures are required. The area containing this material should be isolated, at the first instance, from personnel. Abatement is highly recommended at the earliest practicable time.</p>	

Priority 2 – P2	Potential Risk Level
<p>This level of risk is applicable to damaged or unstable material such as broken or deteriorated cement sheeting, which presents a potential health risk if disturbed. Control measures to stabilise the material should be initiated immediately to prevent the chance of the contamination spreading to other areas. Formal abatement should be considered.</p>	

Priority 3 – P3	Low Risk Level
<p>This level of risk is applicable to damage non-friable or stable material that may require some minor maintenance. Maintenance work should be carried out to stabilise and repair the damaged area. Control must be implemented to protect these materials from further damage</p>	

Priority 4 – P4	Negligible Risk Level
<p>This level of risk is applicable to non-friable or stable materials, such as painted cement sheeting, vinyl floor tiles, etc. It is unlikely for these materials to present a health risk unless damaged, cut, sanded, abraded or machined. These materials should be maintained in good condition and reassessment of the priority rating will be required if any maintenance or building works impact on their condition.</p>	

References

- How to Safely Remove Asbestos: Code of Practice. Safe Work Australia. December 2011.
- How to Manage and Control Asbestos in the Workplace: Code of Practice. Safe Work Australia. December 2011.
- Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres. 2nd Edition. WorkSafe Australia, [NOHSC: 3003 (2005)]

Appendix A



Asbestos Register

Building ID: B01

LOCATION	DETAILS	RISK	Asbestos
Deposit ID: PTM102 Sample ID: Ground Throughout Ceilings 	Application: Linings Description: Gyprock Accessibility: Accessible Amount: Recommendations: Due Date:	Status: Not Present Substance Type: Condition: Not Applicable Damage or Deterioration Potential: Not Applicable Activities that May Disturb Material: Remedial Action: Not Applicable Audit Findings: Assessed: 2015-07-27 Risk Ass. None	
Deposit ID: PTM100 Sample ID: Ground Throughout Floors 	Application: Coverings Description: Carpet/Vinyl sheet and Ceramic Tiles Accessibility: Accessible Amount: Recommendations: Due Date:	Status: Not Present Substance Type: Condition: Not Applicable Damage or Deterioration Potential: Not Applicable Activities that May Disturb Material: Remedial Action: Not Applicable Audit Findings: Assessed: 2015-07-27 Risk Ass. None	
Deposit ID: PTM101 Sample ID: Ground Throughout Walls 	Application: Linings Description: Gyprock & Masonry Accessibility: Accessible Amount: Recommendations: Due Date:	Status: Not Present Substance Type: Condition: Not Applicable Damage or Deterioration Potential: Not Applicable Activities that May Disturb Material: Remedial Action: Not Applicable Audit Findings: Assessed: 2015-07-27 Risk Ass. None	
Deposit ID: PTM104 Sample ID: Ground Warehouse Walls and Ceilings	Application: Linings Description: Coolroom panels Accessibility: Accessible Amount: Recommendations: Due Date:	Status: Not Present Substance Type: Condition: Not Applicable Damage or Deterioration Potential: Not Applicable Activities that May Disturb Material: Remedial Action: Not Applicable Audit Findings: Assessed: 2015-07-27 Risk Ass. None	

Appendix B

Site Plan

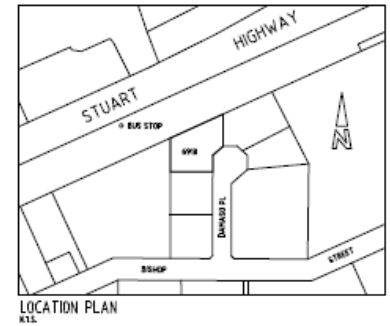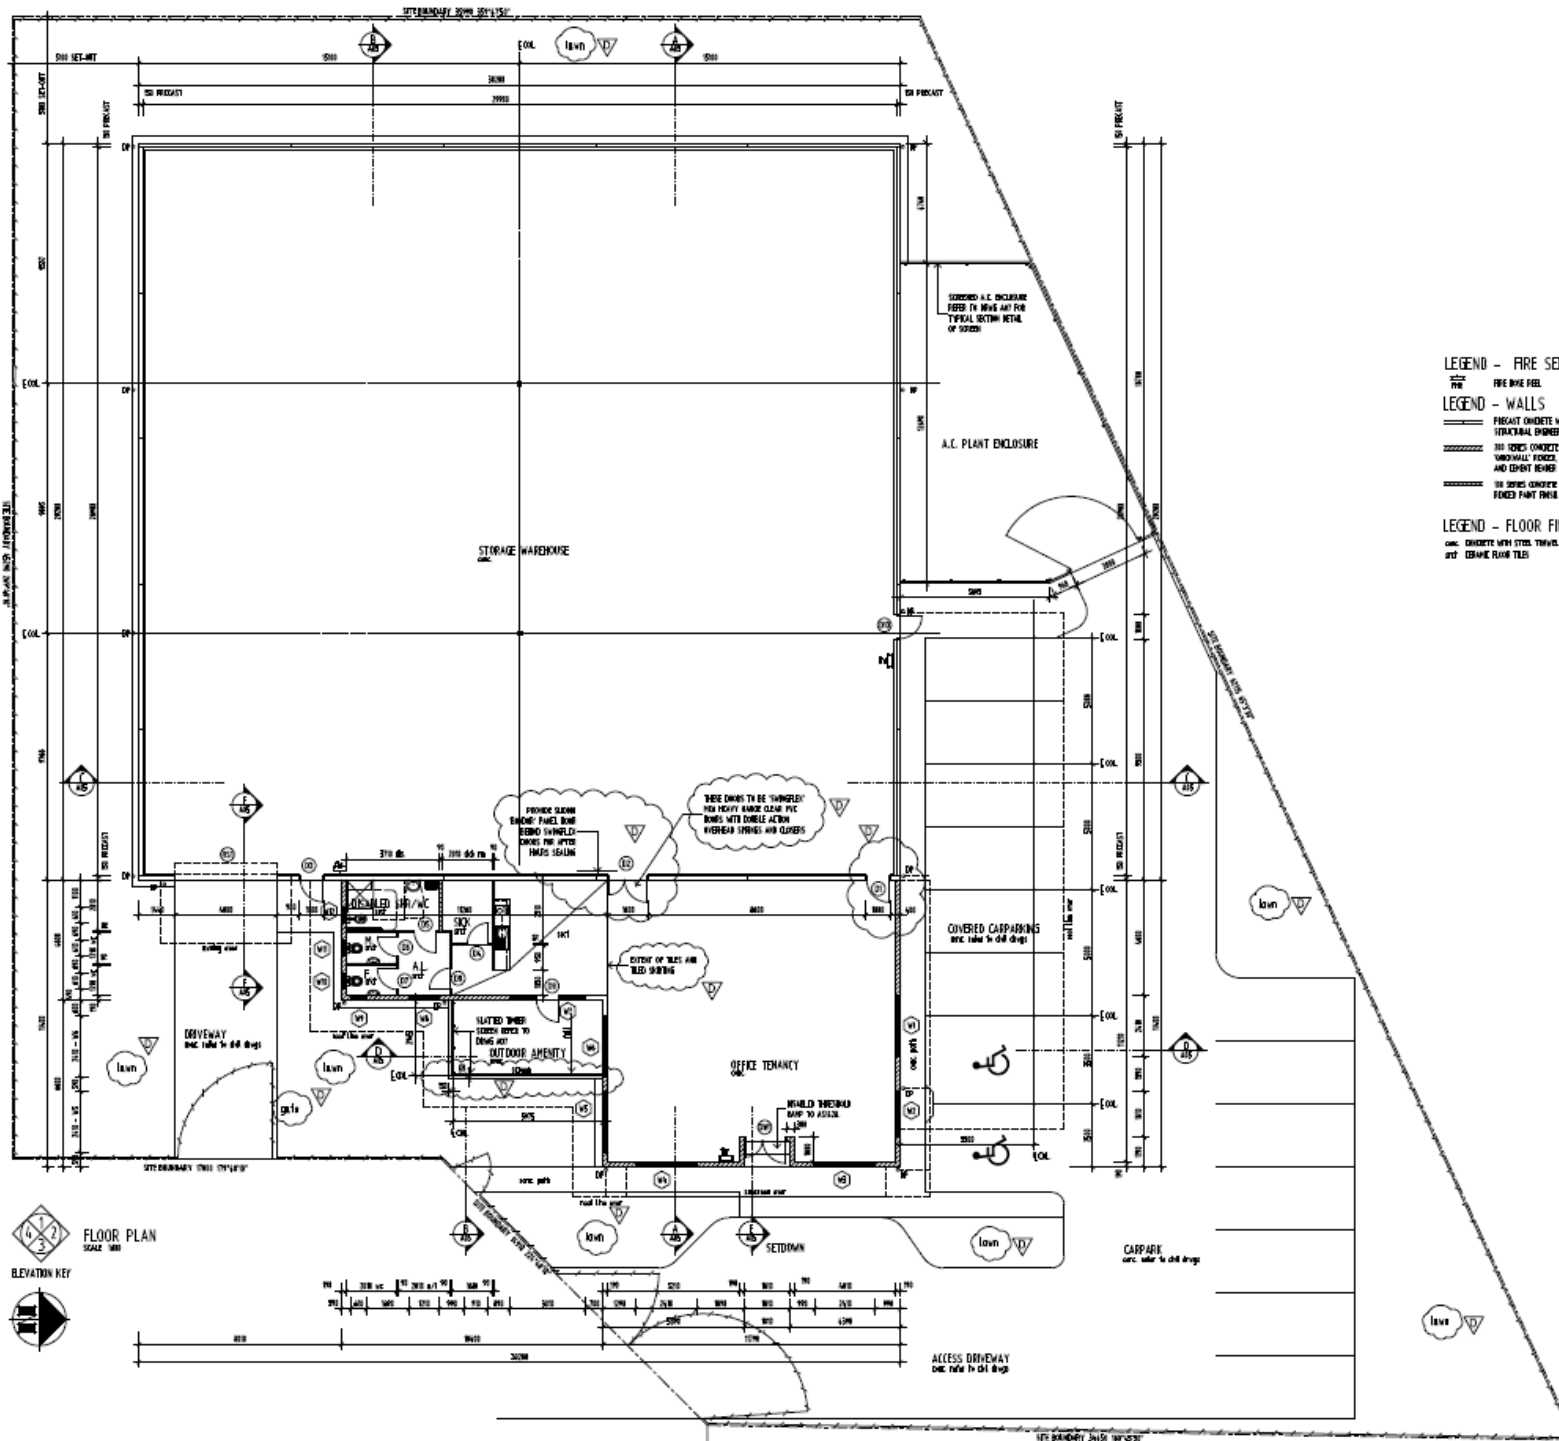

LEGEND - FIRE SERVICES

--- FIRE RISK FEEL

LEGEND - WALLS

--- PRECAST CONCRETE WALL AS DETAIL IN THE STRUCTURAL ENGINEER'S DRAWINGS

--- 300 THICK CONCRETE BLOCKWORK WITH UNPAINTED FENCIBLE FINISH EXTERNALLY AND EXPOSED REINFORCING BARS INTERNALLY

--- 100 THICK CONCRETE BLOCKWORK WITH EXPOSED FINISH FINISH

LEGEND - FLOOR FINISHES

--- CONC. CONCRETE WITH STAIN TREATMENT

--- CERAMIC FLOOR TILES

GENERAL NOTES:

1. FLOOR TO FLOOR HEIGHTS, CLIMAT AND OTHER ALL DIMENSIONS OF THE BUILDING SHALL COMPLY WITH THE ARCHITECT FOR CLARIFICATION AND MODIFICATION.
2. VERIFY ALL DIMENSIONS AT THE SITE BEFORE COMMENCING ANY ON SITE WORKS.
3. ALL WORKSHOPS TO BE IN ACCORDANCE WITH ANY RELEVANT AUSTRALIAN STANDARDS PROVIDED BY THE STANDARDS ASSOCIATION OF AUSTRALIA.
4. WHERE DUTY STANDARDS ARE GIVEN, THESE REFER TO THE 'NEEDED TO COMPLY' STANDARDS PROVIDED BY THE CITY OF DARWIN AND FINANCIAL.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE STRUCTURE DESIGN SECTION AND PROVIDE ADEQUATE PROVISION AND SUPPORT.
6. GENERALLY, INTERNAL LIGHTING TO BE IN ACCORDANCE WITH AS 1600.
7. ALL BATHROOMS AND HIGHWAY AREAS TO BE VENTILATED BY R/A F.A. AND MECHANICAL MEANS.
8. DET BOND AND DIMS IN THE PATH OF TRAVEL, TO AN EXIT ARE REQUIRED TO BE VENTILATED WITHIN 100MM OF THE WALL OR A WALL WITH LOCATED BETWEEN THE 2 100MM BOND FLOOR LEVELS TO CORRECT WITH CLEARANCE OF THE WALL.
9. FLOOR FINISHES TO BE IN ACCORDANCE WITH THE ARCHITECT'S DRAWINGS. SLOPE AND 100MM BOND SHALL BE IN ACCORDANCE WITH 110.0. OF AS/NZS 1100.
10. REPAIRS TO BE COMPLY TO AS 1600.
11. PROVIDE SUFFICIENT TYPICAL DIMENSIONS TO PERMITS AND OTHER TYPICAL DIMENSIONS AS REFERENCED BY THE ARCHITECT'S DRAWINGS.
12. PROVIDE FIVE DIMENSIONS AS REFERENCED BY THE ARCHITECT'S DRAWINGS AND AS SHOWN IN THE DRAWINGS.

WET AREAS

1. ALL FLOORS IN WET AREAS TO HAVE SELECTED RANGE OF CERAMIC FLOOR TILES SHALL TO HAVE CERAMIC WALL TILES IN OTHER INTERIOR AREA FALL ALL FLOORS TO WALLETS.
2. ALL WET AREA WALLS AND FLOORS TO HAVE A WATERPROOF MEMBRANE REED TILES IN THE EXISTING BOUNDARY AS 374-PM4 AND AS PART 541.

FINISHES

1. FINISHES SUCH AS CARPET, WALLS, LIGHTING ETC. TO COMPLY WITH SPECIFICATION CLAUSE OF THE B.C.

**JACKMAN
GOODEN
ARCHITECTS**

JACKMAN GOODEN ARCHITECTS (NT) PTY LTD
5 GARDENERS STREET, DARWIN NT 0800
GPO BOX 175, DARWIN NT 0801
TELEPHONE (08) 8981 8468 FAX (08) 8981 2858
EMAIL jgoin@comcast.com.au ASN 59 009 626 926

**CENTRELINK
OFFSITE FILE STORAGE UNIT
LOT 6918 DAMASD PLACE
STUART PARK N.T.**

PROJECT	CENTRELINK OFFSITE FILE STORAGE UNIT
SITE	LOT 6918 DAMASD PLACE, STUART PARK N.T.
FLOOR PLAN	
DATE	AS NOTED
SCALE	A15 2002
DESIGNER	JGC
CHECKER	SH
PROJECT NO.	2314-A01
DATE	D